


FLOOR PLAN

SCALE 1/4" = 1'-0"


MARK	SIZE	DESCRIPTION	NO. REQ.
1	2'-8" x 6'-8" x 1 3/8"	FLUSH INTERIOR	2
2	2'-4" x 6'-8" x 1 3/8"	"	2
3	1'-8" x 6'-8" x 1 3/8"	"	3
4	3'-0" x 6'-8" x 1 3/4"	FLUSH EXTERIOR	2
5	3'-0" x 6'-8" x 1 3/4"	HALF GLAZED EXT.	1
6	3'-0" x 6'-8" x 1"	SCREEN	3
7	3'-0" x 6'-8" x 1 3/4"	FULLY GLAZED EXT.	1
8	6'-0" x 6'-8" x 1 3/4"	INT. SLIDING - 3 PANEL	2

MARK	SIZE	DESCRIPTION	NO. REQ.
A	4'-0" x 4'-4"	FIXED GLASS	1
B	4'-0" x 6'-0"	D. H. ALUM. - 2 UNITS	1
C	4'-0" x 2'-10"	DOUBLE HUNG ALUM.	4
D	3'-0" x 2'-10"	"	1
E	2'-6" x 2'-4"	"	1
F	4'-0" x 2'-0"	"	2
G	3'-0" x 6'-8"	FIXED GLASS	1

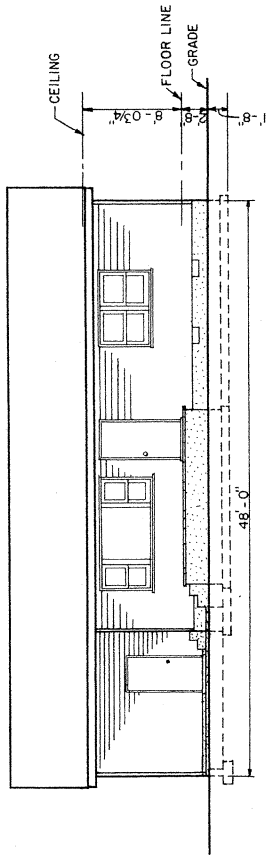


FRONT ELEVATION

SCALE 1/8" = 1'-0"

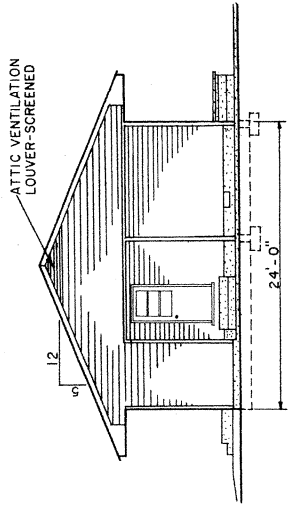


LEFT ELEVATION

SCALE 1/8" = 1'-0"

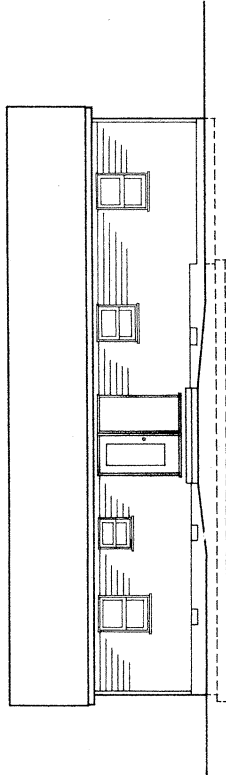


REAR ELEVATION


SCALE 1/8" = 1'-0"

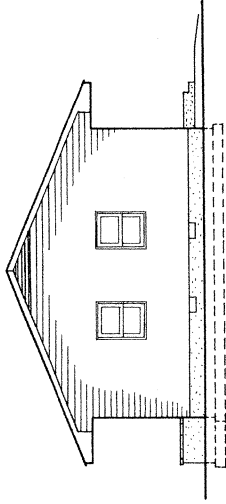

RIGHT ELEVATION

SCALE 1/8" = 1'-0"

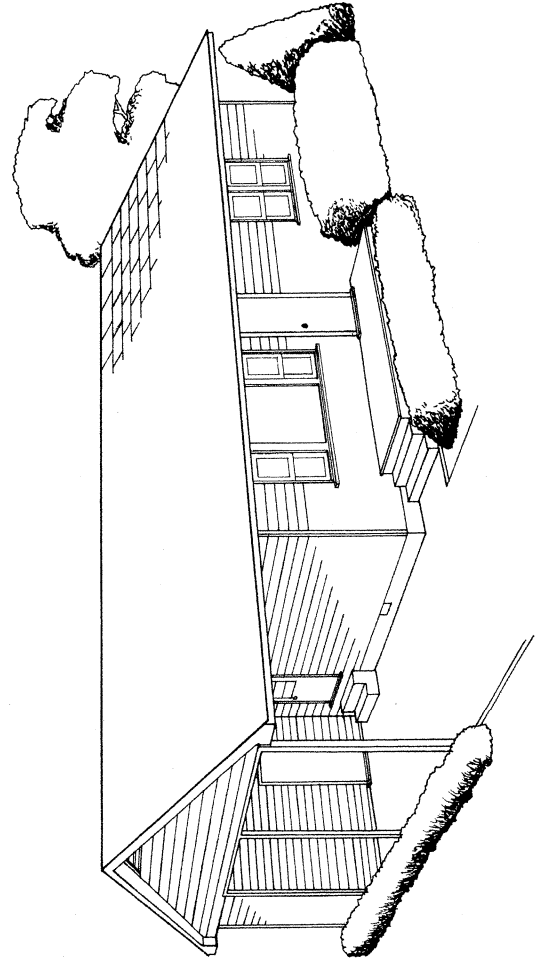

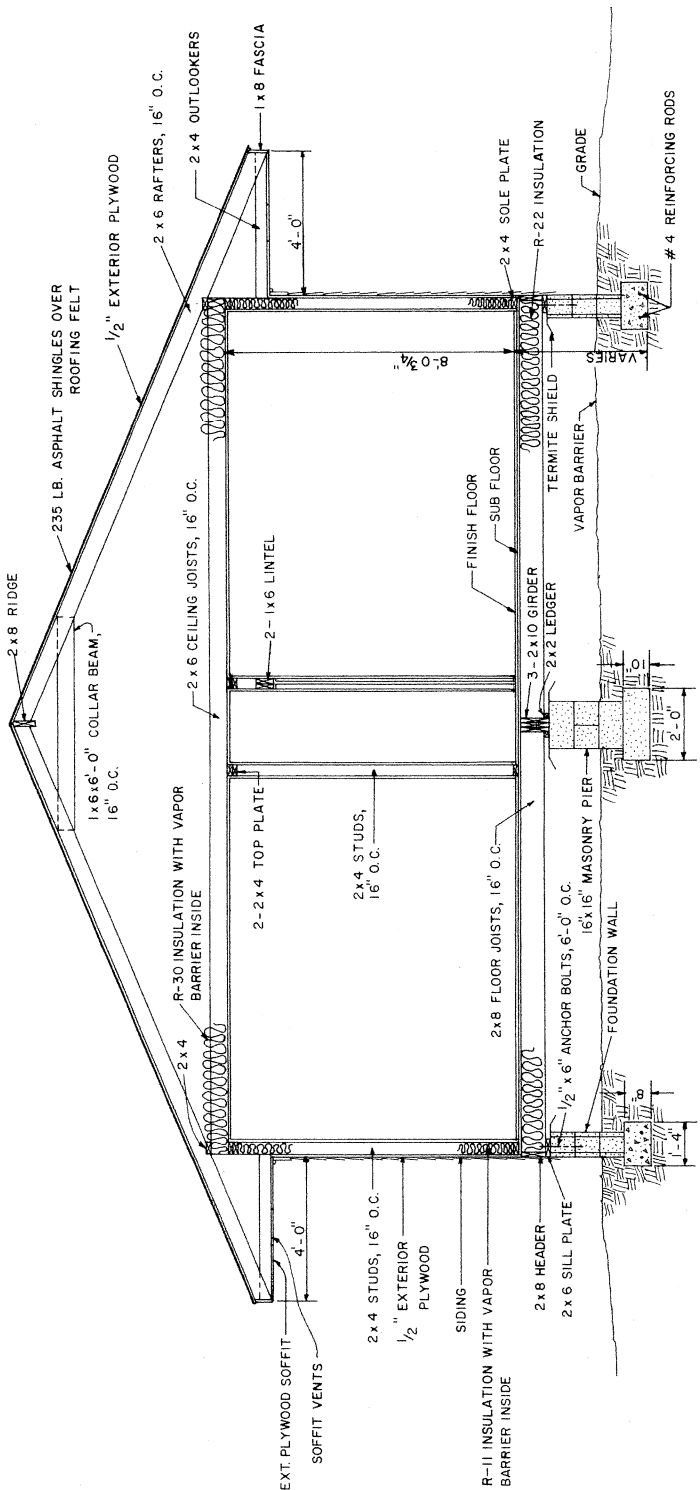


SECTION A-A

SCALE 3/8" = 1' - 0"

CONSTRUCTION CHECK LIST

1. CHECK LOCAL BUILDING CODE & LOAN COMPANY CRITERIA (RAFTERS MEET 20 LB/FT² SNOW LOAD CRITERIA).
2. ADEQUATELY NAIL & ANCHOR JOINTS.
3. DOUBLE JOISTS UNDER TUBS & OTHER HEAVY LOADS.
4. SHEATH CORNERS WITH 1/2" PLYWOOD OR HIGH DENSITY FIBERBOARD OR USE DIAGONAL BRACING.
5. USE EXTERIOR GLUED PLYWOOD WHEREVER IT MAY BE WETTED DURING OR AFTER CONSTRUCTION.
6. PRESSURE TREAT ALL WOOD WITH GROUND CONTACT AND PROVIDE OTHER NEEDED TERMITE CONTROL.
7. R VALUES DEPEND ON LOCAL CLIMATE AND FUEL COST.
8. PROVIDE 1 SQ FT OF ATTIC VENT OPENINGS FOR EACH 150 SQ FT OF CEILING.
9. WEATHERIZE ALL OPENINGS AND JOINTS.

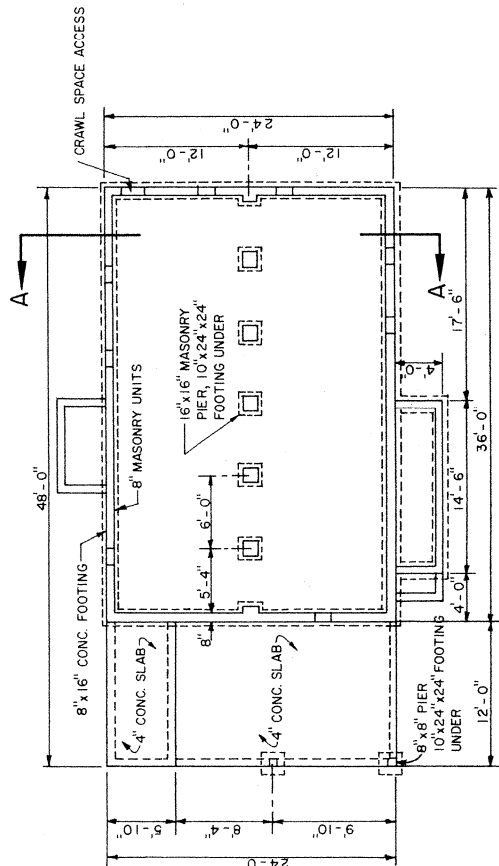

FOUNDATION PLAN

SCALE 1/8" = 1' - 0"

